


JFD Standard Evolution 13

Single Engine Reverse Lay to FDC

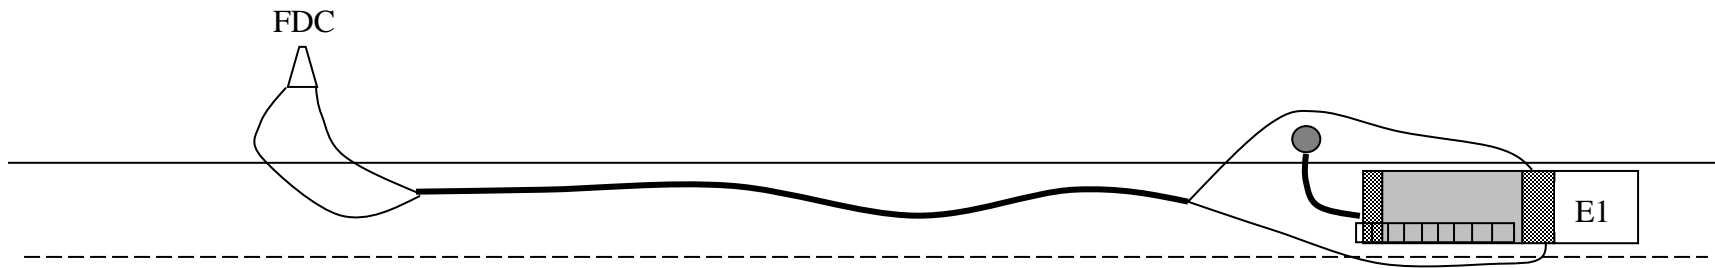

E1 stops at the FDC removed any needed equipment

- 5" to 2 1/2" gated wh
- 200' of 2 1/2" hose

E1 reverse lay a 5" LDH from the FDC to the hydrant

E1 establishes a water supply to the FDC

- Non-flowing Sprinkler system supply at 100 psi
- Flowing sprinkler system 150 psi
- Standpipe is (desired nozzle pressure + elevation + appliance)

Operate the line(s) at proper pressure and flow

Target Times
2-person crew 6 minutes